

# FLOWTITE PRODUCTS

SEPTIC/WASTE WATER

NOTE: CUSTOMER SUPPLIED  
"ASTM C-1644" APPROVED  
FLEXIBLE PIPING COUPLING  
REQUIRED ON TANGENTIALLY  
MTD. NOZZLES, & PIPES


SHELL CODES: 2-EXS11SD, 1-OXS10SD



THIS IS AN IAPMO APPROVED TANK  
THE ONLY CHANGE ALLOWED TO  
THIS TANK IS TO INCREASE THE  
INLET AND OUTLET PIPE DIAMETER.  
MFG. PER. PE-C22.85

### CAPACITIES:

LIQUID VOLUME BELOW OUTLET = 26,380 GALS  
AIR VOLUME ABOVE OUTLET = 3,436 GALS

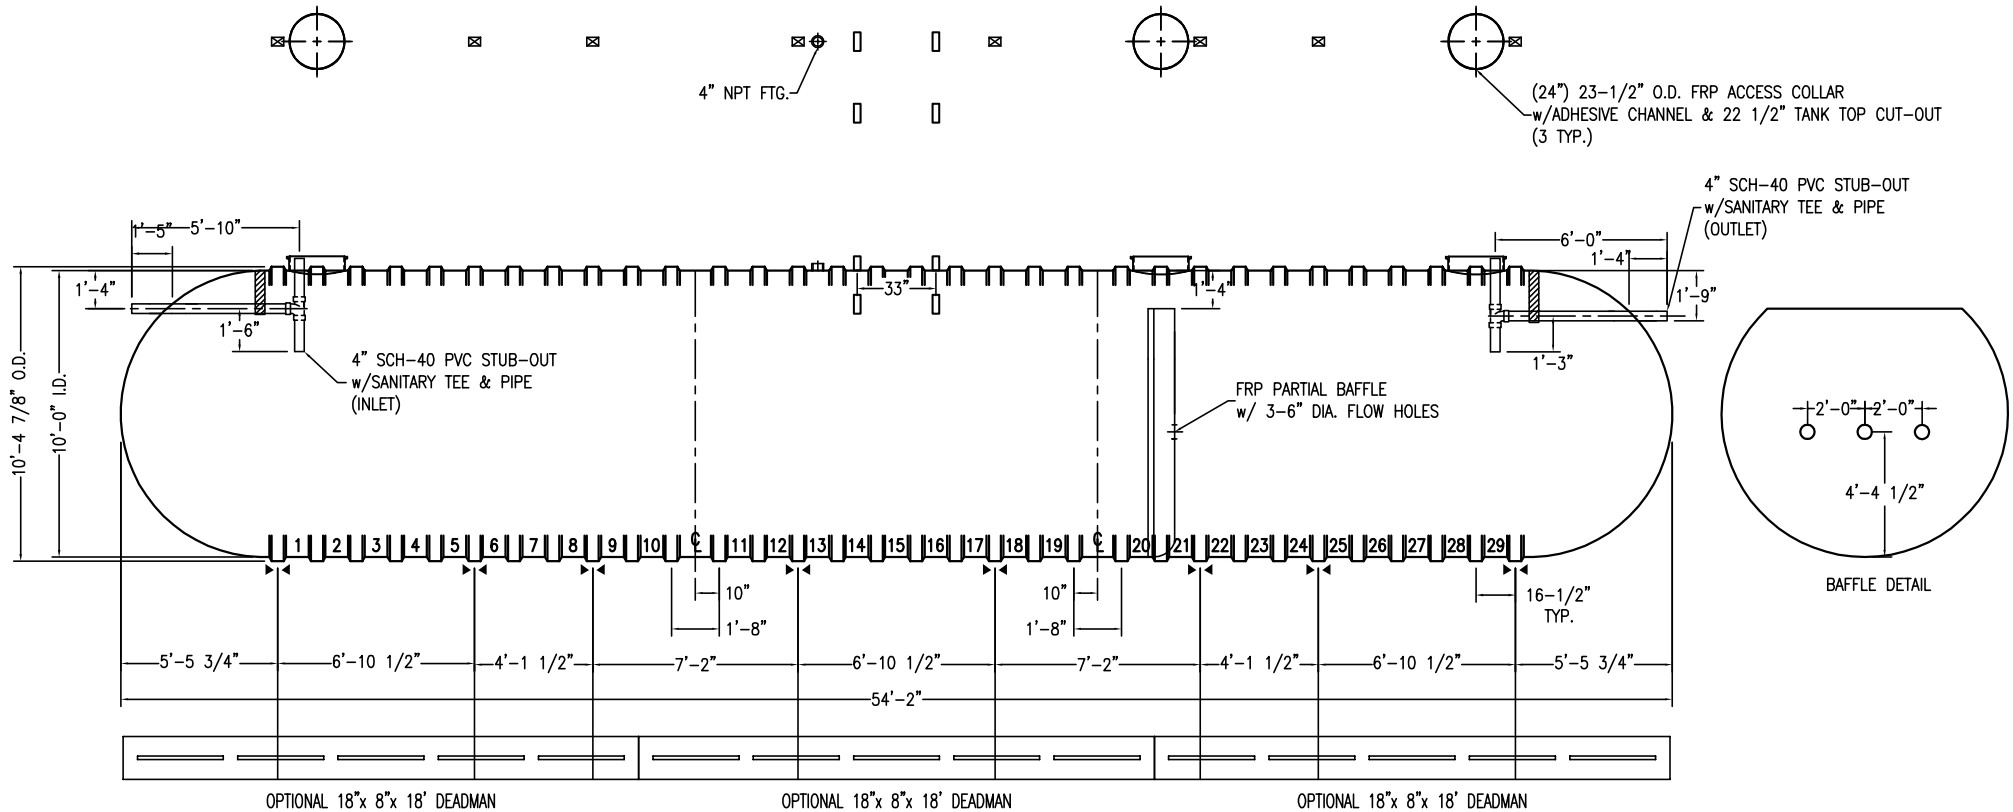

### NOTES:

- ☒ HOLD DOWN STRAP CLIP
- ▶◀ HOLD DOWN STRAP LOCATION
- TYPE "13" LIFT LUG - SD
- TYPE "13" LIFT LUG - HD

SWT D-6 (10')-30000		DATE:	1/1/2014
IAPMO SEPTIC TANK		DRAWN BY:	J.HARMON
	CAPACITY:	29,816	REVISED:
	WEIGHT: DRY/WET	8750	DWG NUMBER: