

FLOWTITE PRODUCTS

SEPTIC / WASTE WATER

NOTE: CUSTOMER SUPPLIED
"ASTM C-1644" APPROVED
FLEXIBLE PIPING COUPLING
REQUIRED ON TANGENTIALLY
MTD. NOZZLES, & PIPES

SHELL CODES: 2-EXS10SD, 1-OXS08SD





THIS IS AN IAPMO APPROVED TANK
THE ONLY CHANGE ALLOWED TO
THIS TANK IS TO INCREASE THE
INLET AND OUTLET PIPE DIAMETER.
MFG. PER. PE-C22.85

CAPACITIES:
LIQUID VOLUME BELOW OUTLET = 35,212 GALS
AIR VOLUME ABOVE OUTLET = 4,642 GALS



(24") 23-1/2" O.D. FRP ACCESS COLLAR
w/ADHESIVE CHANNEL & 22 1/2" TANK TOP
CUT-OUT (3 TYP.)

4" SCH-40 PVC STUB-OUT
w/SANITARY TEE & PIPE
(OUTLET)

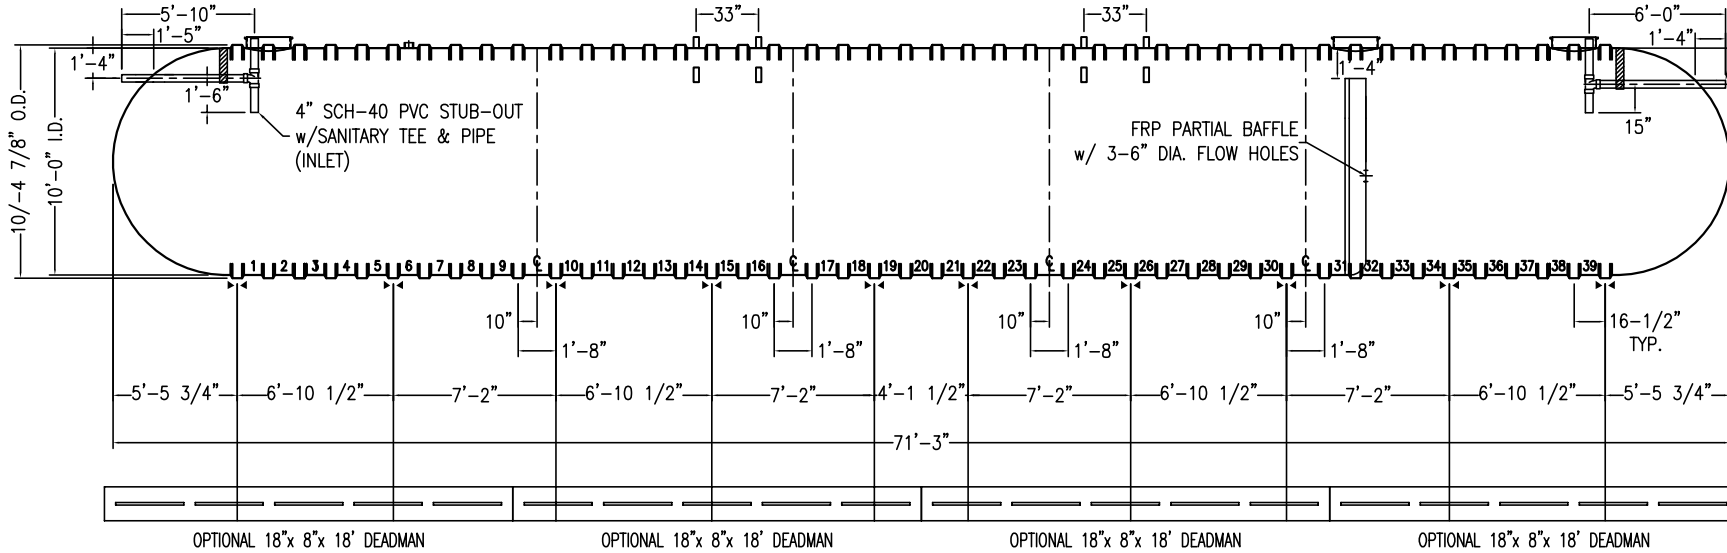

- NOTES:
- ☒ HOLD DOWN STRAP CLIP
 - ▶◀ HOLD DOWN STRAP LOCATION
 - TYPE "13" LIFT LUG - SD
 - TYPE "13" LIFT LUG - HD

SWT D-6 (10')-40000		DATE:	1/1/2014
IAPMO SEPTIC TANK		DRAWN BY:	J.HARMON
	CAPACITY:	39,854	
	WEIGHT: DRY/WET	11600	
		REVISED:	
		DWG NUMBER:	1040SW-IS