
| MARK | EQUIPMENT LISTING AND SUPPLIER | MARK | EQUIPMENT LISTING AND SUPPLIER |
|------|--|------|---|
| Α | C.S.I. DOUBLE WALL FIBERGLASS TANK | I | HYDROSTATIC RESERVOIR w/ 4" PVC MONITORING RISER |
| В | C.S.I. FIBERGLASS HOLD DOWN STRAP & TURNBUCKLE ASSEMBLY | J | 22" FIBERGLASS FLANGED MANWAY w/ COVER & IDENTIFICATION PLATE |
| С | C.S.I. PRECAST CONCRETE DEADMAN ANCHOR WITH EYEBOLTS | К | 6" FIBERGLASS FLANGE - INLET |
| D | 22" FIBERGLASS FLANGED MANWAY w/COVER & 8" VERAC DUMPING HATCH | L | 6" FIBERGLASS FLANGE w/ STEEL BLIND FLANGE - SPARE |
| E | 6" FIBERGLASS FLANGE w/ 6" VAREC GAUGE HATCH & 3" BAYCO STATION VENT | М | 3" STEEL PUMP-OUT / SUCTION PIPE |
| F | 6" FIBERGLASS FLANGE w/ RISER REDUCER & 3" PUMP-OUT ASSEMBLY | N | PVC INFLUENT DRAIN PIPE TO TANK |
| G | 6" FIBERGLASS FLANGE w/ RISER | 0 | 22" FIBERGLASS FLANGED MANWAY EXTENSION |
| Н | 6" FIBERGLASS FLANGE w/ RISER | Р | PIPLINE PIGGING STATION |



NOTE: All 6" FIBERGLASS FLANGES ARE FLAT FACED ANSI/ASME B16.5 CLASS 150, 25 PSI

THIS DRAWING IS FOR ILLUSTRATIVE PURPOSES ONLY. IT IS THE RESPONSIBILITY OF THE PURCHASER ADD/OR ENGINEER TO DESIGN A SYSTEM IN COMPLIANCE WITH ALL GOVERNING MUNICIPAL CODES.

TYPICAL ILLUSTRATION DRAWING UNDERGROUND PIPELINE SUMP TANK

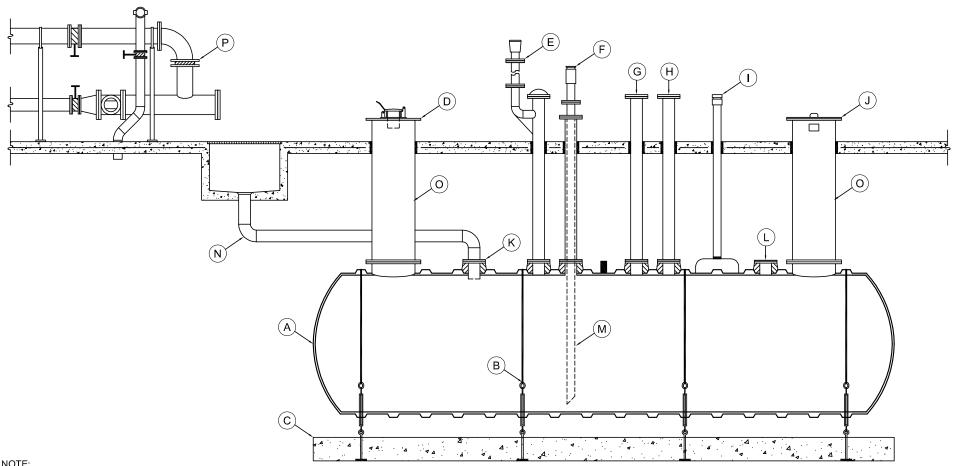